



FIREMIKS

PISTON PUMP TYPE FOR FIXED INSTALLATIONS

Approval FM Class 5130, no 3060416



Dosing system for firefighting - for fixed installations connected to an atmospheric concentrate tank with gravity feed to dosing pump. Consists mainly of two volumetric parts; a Water motor and a Piston pump. Equipped with a Manual air relief valve. Flushing of dosing pump is done automatically when the concentrate inlet is closed with 3-way ball valve, (no 4 on Flow chart).

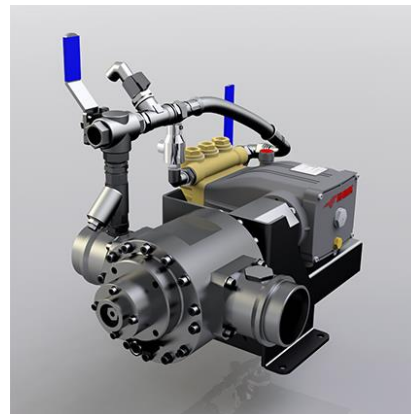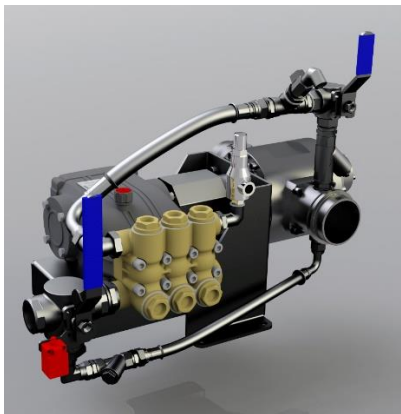

TECHNICAL DATA

PRODUCTS:	Flow range lpm	Nominal water line
FIREMIKS 450-3-PP-F-ALU-FM	112 – 450	2" (50)
FIREMIKS 800-3-PP-F-ALU-FM	135 – 800	2,5" (65)
FIREMIKS 1200-3-PP-F-ALU-FM	260 – 1200	3" (80)
FIREMIKS 1800-3-PP-F-ALU-FM	240 – 1800	4" (100)
FIREMIKS 2400-3-PP-F-ALU-FM	311 – 2400	4" (100)
FIREMIKS 3200-3-PP-F-ALU-FM	500 – 3200	5" (125)
<p><i>Note! Maximum water flow rate is the approved maximum continuous flow rate entering the FIREMIKS. The unit has been tested for 40% overflow for 3 minutes (3200-unit for 25% overflow for 10 minutes) at start-up without any damage. During overflow/overspeed, the correct dosing might not be achieved.</i></p> <p><i>Minimum water flow rate varies depending on system pressure and viscosity properties of the concentrate. Minimum flow rate is here defined as the lowest flow rate where the dosing is correct, above 3,0%, at 4 bar inlet pressure.</i></p>		
Nominal dosing rate:	3 % (approved range 3,0-3,9 %)	
Approved viscosity range:	1 cps – 1800 cps at 60 rpm with Brookfield viscometer, spindle #4 (3500 cps at 30 rpm)	
Max inlet operating pressure:	16 bar (232 psi)	
Factory tested pressure:	24 bar (348 psi)	
Suction height:	0 meters (0 ft) Gravity feed	
<p><i>The pump has suction capability, but it is not recommended to be relied upon for safe operation. Suction requires priming of the pump and will lower dosing performance.</i></p>		
Operation temperature:	1°C to 55 °C (34°F to 131°F)	
Storage temperature, dry condition:	-30°C to 55°C (-22° to 131°F)	

MATERIALS	
Water motor:	Alu AA 6082/7075, Hard-anodized and PTFE-coated, AISI 316 (fasteners), PET (vanes), NBR (O-rings).
Dosing pump:	Aluminium, brass, ceramics, NBR, AISI 316 (fasteners)
Fittings:	High grade stainless steel
Valves and hoses:	High grade stainless steel + PTFE
OPTIONAL	
Dosing return valve with pressure relief valve	Valve for returning the concentrate to the tank for easy and quick checking of admixture rate, without consuming concentrate and generating water/foam solution. Pressure relief valve included and set to open at 20 bar.
Reversed Flow direction (right to left)	Standard flow direction is from left to right seen from pump side
Adapters for water motor connections	Flanges of different kinds (ANSI, DIN), Storz couplings, etc
Y-strainer main water flow	If the firefighting water contains foreign particles a strainer in the main water line before the FIREMIKS is a necessity

While the above numbers are correct to our best knowledge, for best practice we strongly recommend contacting us with your dosing case, stating the required flows and pressures, the data sheet of the concentrates to be used and any other useful information, so we can provide you with our most suitable dosing solution.



Certificate of Compliance

This certificate is issued for the following:

FIREMIKS[®]

Foam Concentrate Proportioner Systems

Models: 450-3-PP-F-ALU-FM, 800-3-PP-F-ALU-FM, 1200-3-PP-F-ALU-FM, 1800-3-PP-F-ALU-FM, 2400-3-PP-F-ALU-FM, & 3200-3-PP-F-ALU-FM

<p>Prepared for: Firemiks AB P.O. Box 8155 Stockholm, SE-104 20 Sweden</p>	<p>Manufactured at: Firemiks AB Bergkällavägen 35B, Sollentuna, SE-192 79 Sweden</p>
---	---

FM Approvals Class: 5130

Approval Identification: 3060416 Approval Granted: January 9, 2018

To verify the availability of the Approved product, please refer to www.approvalguide.com

Said Approval is subject to satisfactory field performance, continuing Surveillance Audits, and strict conformity to the constructions as shown in the Approval Guide, an online resource of FM Approvals.




David Fuller
 VP - Manager of Fire Protection
 FM Approvals
 1151 Boston-Providence Turnpike
 Norwood, MA 02062 USA




Member of the FM Global Group

FLOW CHART

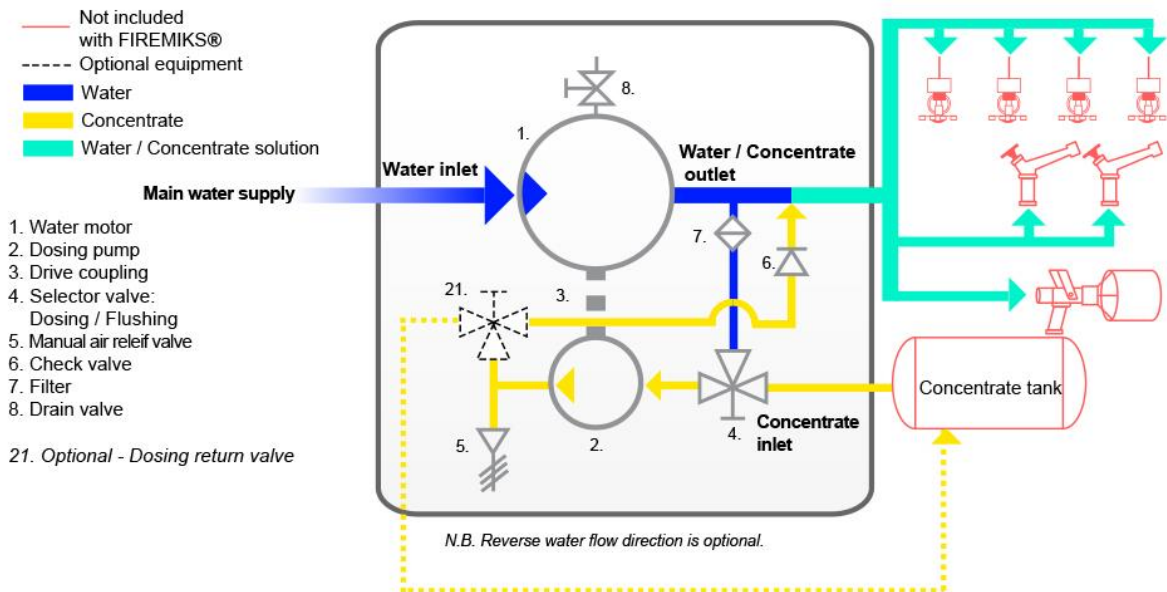

OVERVIEW

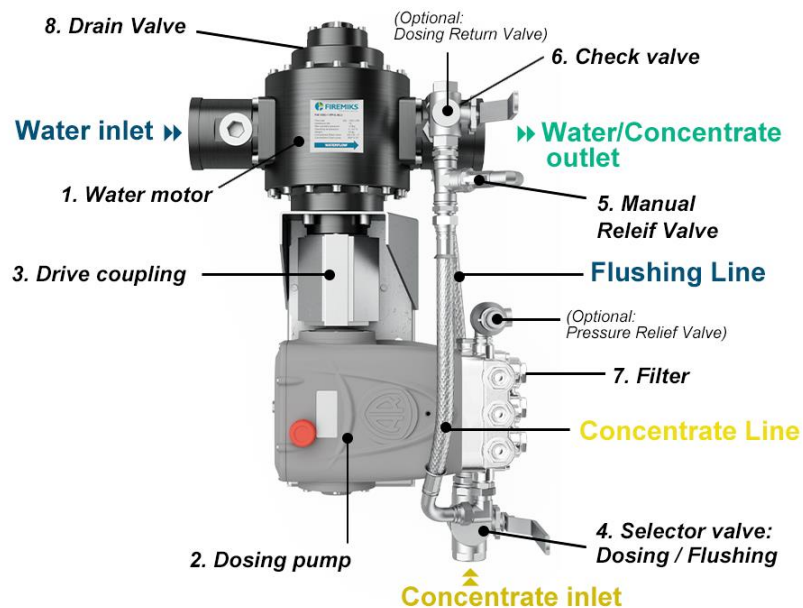



Note: For illustration only. Refer to Dimensional Drawing for accurate representation of each model.

FIREMIKS® is a registered trademark owned by Firemiks AB in Sweden.



For info on our FM-approval: www.approvalguide.com

We reserve the right to make changes in the specifications without prior notice. Production is made according to European Directive 2006/42/EC  and conforms to applicable parts of NFPA 11 and NFPA 1901. 

Document: Data Sheet FIREMIKS Overview FM-line (ver 03)

Approved by: PA/MA

Version: 03

Date: 2018-10-22