


RevNo	Revision note	Date	Signature	Checked
A	Pressure relief return line corrected	2019-09-26	WALLE	MAT

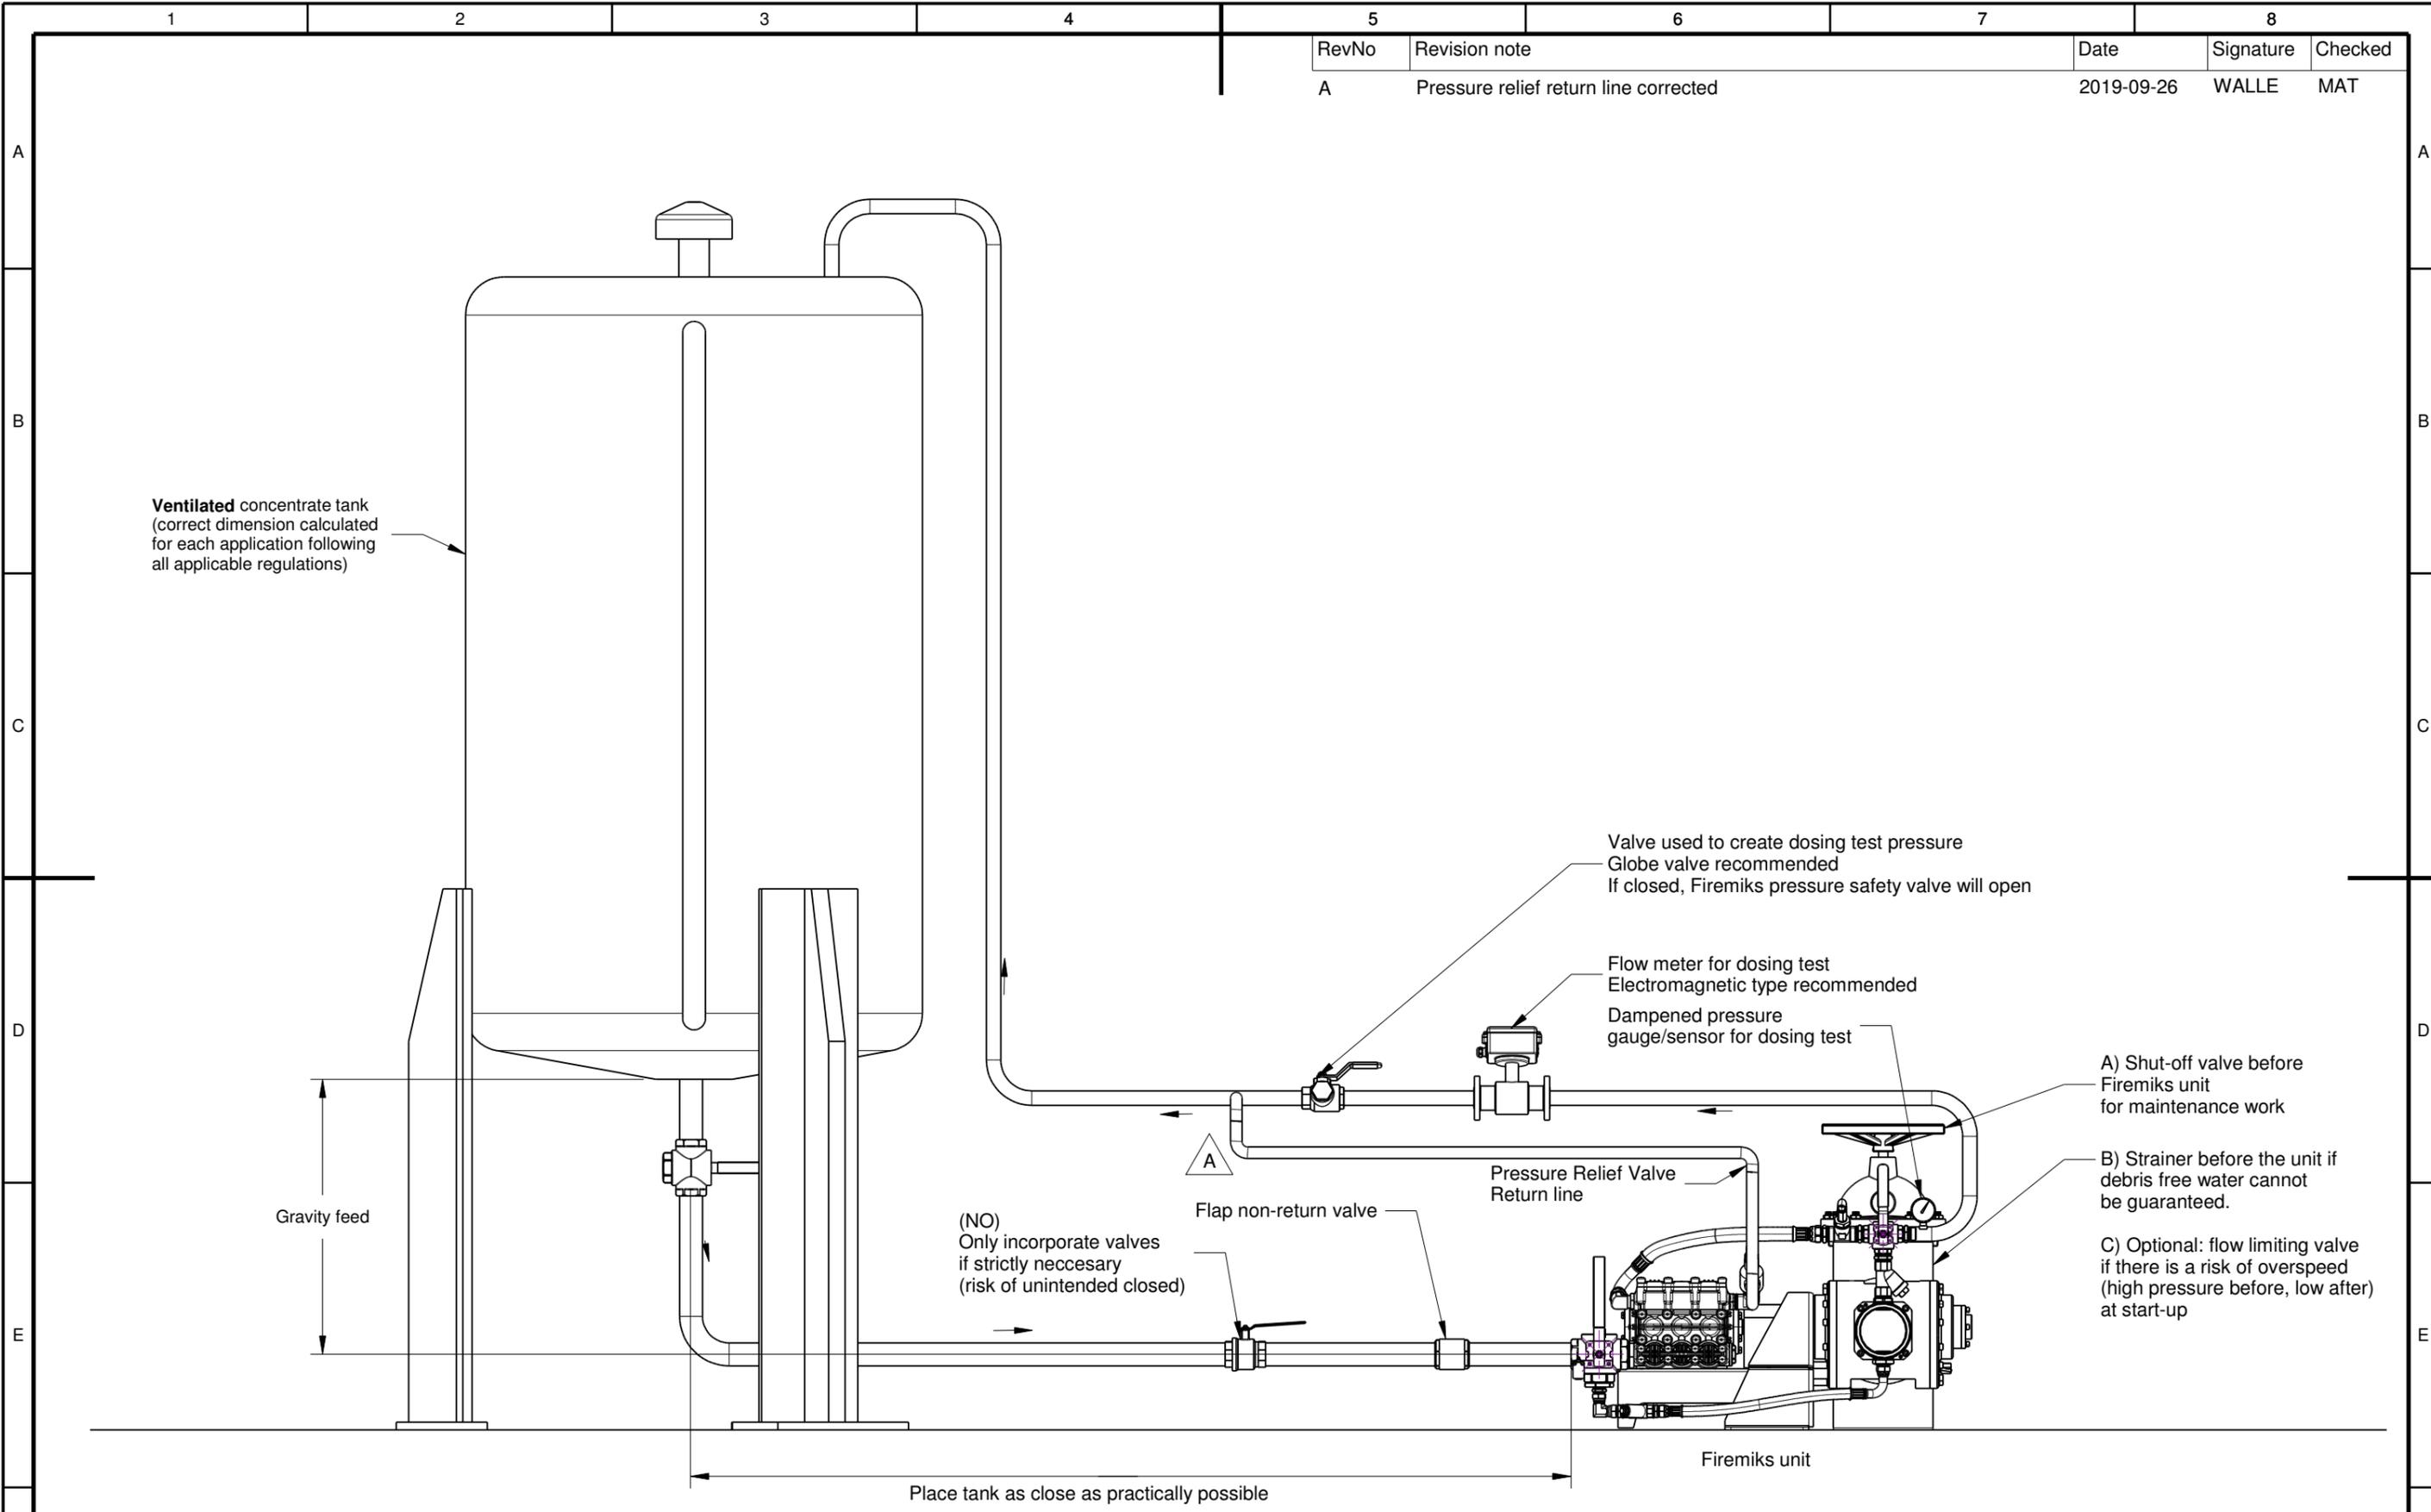

For illustration only
 Always consult the latest edition of the instruction manual valid for your Firemiks unit

Drawn by Walle	Checked by	Approved by - date	Date 2018-12-07	Scale
Firemiks AB P.O.Box 8155 SE-104 20 STOCKHOLM, Sweden info@firemiks.com +46-8-551 196 10			Firemiks recommended principal tank layout with DRV	
Copyright of Firemiks AB All rights reserved - Authorised use only			Edition	Sheet 1 of 1